




ValueGUARD™ POLYMER STORM PANELS


FRANK L. BENNARDO, P.E.
PE0046549

12/14/2011


PANEL THICKNESSES
POLYOLEFIN: 0.110" TYP
POLYCARBONATE: 0.070" TYP

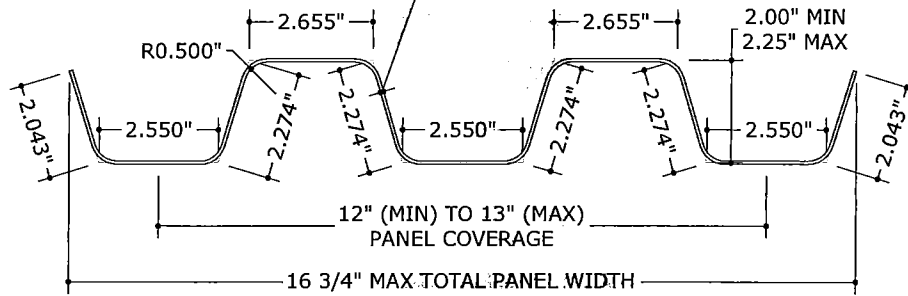


1 FULL PANEL PROFILE
3" = 1'-0" (SEE GEN NOTE 7)

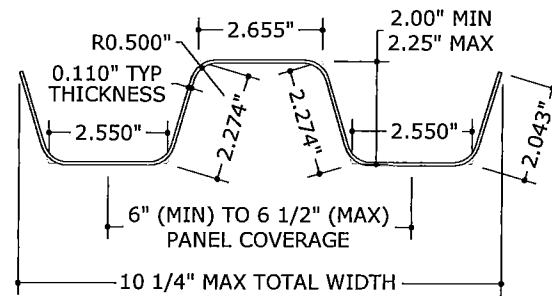


2 HALF PANEL PROFILE
3" = 1'-0" (SEE GEN NOTE 7)

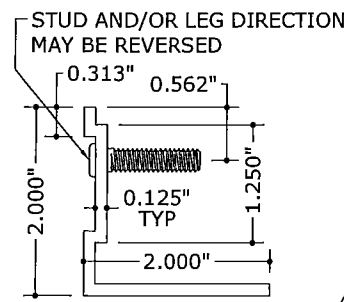


3 STUD ANGLE
6" = 1'-0"




4 REVERSE 'F' ANGLE
6" = 1'-0"

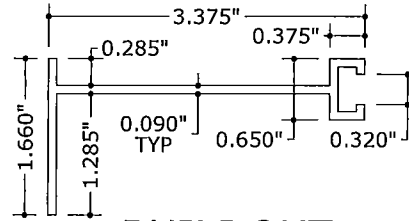


5 BUILDOUT 'F' TRACK
6" = 1'-0"




6 'F' TRACK
6" = 1'-0"




8 KEYHOLE WASHER
6" = 1'-0"

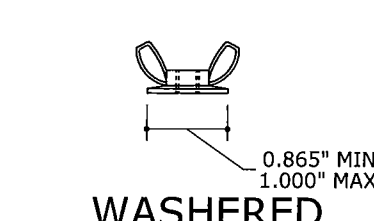


9 WASHERED WINGNUT
6" = 1'-0"

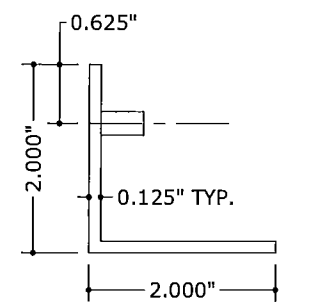


12 ALTERNATE STUD ANGLE
6" = 1'-0"

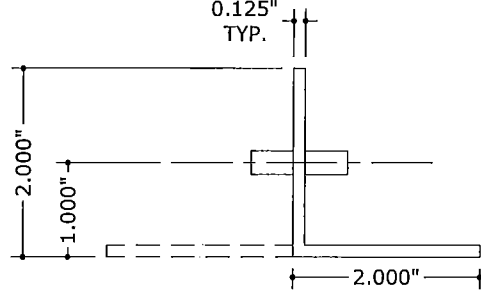


13 STUDDED ANGLE
6" = 1'-0"

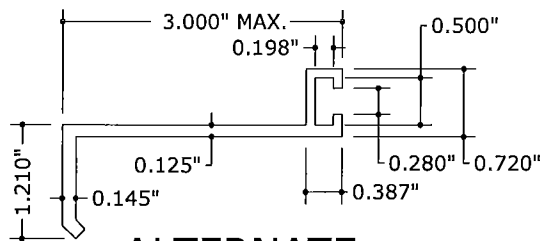


14 ALTERNATE B.O. 'F' TRACK
6" = 1'-0"

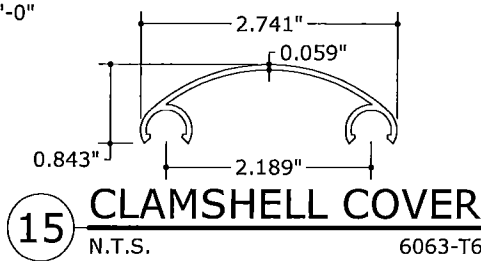


15 CLAMSHELL COVER
N.T.S. 6063-T6

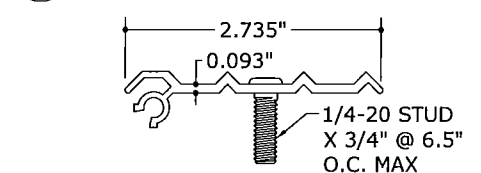


16 CLAMSHELL TRACK
N.T.S. 6063-T6

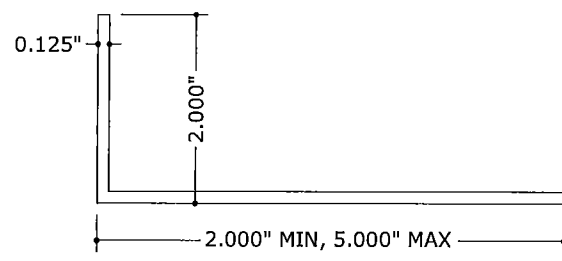

7 CLOSURE ANGLE
6" = 1'-0"

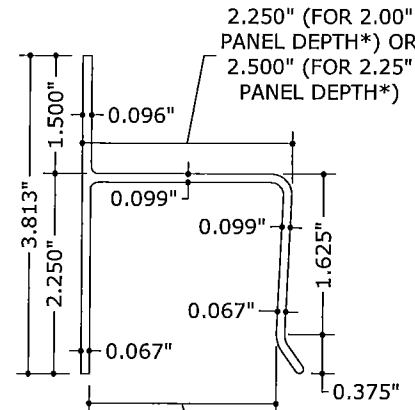

10 'H' HEADER
6" = 1'-0"

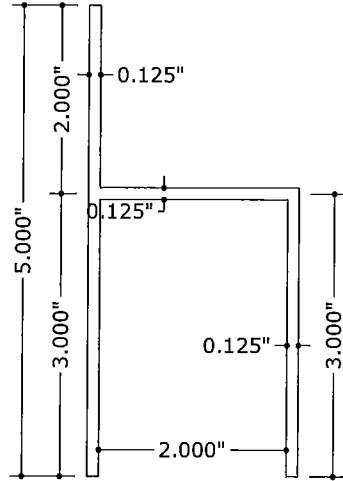

11 SUPER 'H' HEADER™
6" = 1'-0"

*NOTE: PANEL DEPTH SHALL NOT BE LESS THAN HEADER OPENING

GENERAL NOTES:

- THIS SYSTEM HAS BEEN TESTED AND EVALUATED AS A LARGE MISSILE IMPACT PROTECTIVE SYSTEM IN ACCORDANCE WITH THE REQUIREMENTS OF THE 2010 FLORIDA BUILDING CODE AND THE 2009 INTERNATIONAL BUILDING/RESIDENTIAL CODE PER ASTM STANDARDS E330, E1886, & E1996. PANELS ARE APPROVED FOR USE IN FLORIDA OUTSIDE THE HIGH VELOCITY HURRICANE ZONE, OR THROUGHOUT OTHER AREAS GOVERNED BY THE 2009 IBC/IRC.
- NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS PRODUCT. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN PER 2005 NDS SPECIFICATIONS.
- POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE. SITE-SPECIFIC PRESSURE REQUIREMENTS AS DETERMINED IN ACCORDANCE WITH ASCE 7-10 AND CHAPTER 1609 OF THE 2010 FLORIDA BUILDING CODE SHALL BE LESS THAN OR EQUAL TO THE POSITIVE OR NEGATIVE DESIGN PRESSURE CAPACITY VALUES LISTED HEREIN FOR ANY ASSEMBLY AS SHOWN.
- DESIGN PRESSURES NOTED HEREIN ARE BASED ON MAXIMUM TESTED PRESSURES DIVIDED BY A 1.5 SAFETY FACTOR.
- THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. IF SITE CONDITIONS DEVIATE FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS TO BE USED IN CONJUNCTION WITH THIS DOCUMENT.
- THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS IS OUTSIDE THE SCOPE OF THIS CERTIFICATION AND SHALL BE VERIFIED BY OTHERS.
- ALL STORM PANELS (FULL AND HALF, TRANSLUCENT POLYOLEFIN AND TRANSPARENT POLYCARBONATE) MAY VARY IN "COVERAGE WIDTH" BETWEEN THE RESPECTIVE MINIMA & MAXIMA SHOWN HEREIN, PROVIDED THAT THE PANEL PROFILE HEIGHT IS MAINTAINED BETWEEN THE MAXIMUM & MINIMUM SHOWN.
- THIS PRODUCT APPROVAL IS FOR THE USE OF TRANSLUCENT POLYOLEFIN STORM PANELS AND TRANSPARENT POLYCARBONATE PANELS. ALL STORM PANELS SHALL BE MANUFACTURED BY TRANSPARENT PROTECTION SYSTEMS, INC.
- ALL TRANSLUCENT POLYOLEFIN PANELS SHALL BE EXTRUDED FROM SYNTHETIC THERMOPLASTIC POLYMER WITH A PROPRIETARY TPS ADDITIVE FOR ENHANCED UV PROTECTION AND WEATHERABILITY, WITH THICKNESS T=0.110" (±0.011"). TYPICAL TENSILE STRENGTH Fy=4.0 KSI & FLEXURAL MODULUS IS 190.0 KSI.
- ALL TRANSPARENT POLYCARBONATE PANELS SHALL BE EXTRUDED FROM SYNTHETIC THERMOPLASTIC POLYMER RESIN (UV STABILIZED), WITH THICKNESS T=0.070" (±0.007"). TYPICAL TENSILE STRENGTH Fy=8.9 KSI & FLEXURAL MODULUS IS 328.7 KSI.
- ALL EXTRUSIONS SHALL BE 6063-T6 ALUMINUM ALLOY, U.N.O.
- PANELS SHALL BE PERMANENTLY LABELED WITH A MINIMUM OF ONE LABEL PER PANEL CONTAINING THE FOLLOWING:
TRANSPARENT PROTECTION SYSTEMS, INC.
WEST PALM BEACH, FLORIDA
ASTM E330, E1886 & E1996
PRODUCT APPROVAL NUMBER
- STORM PANELS HAVE BEEN DESIGNED AND TESTED TO THE MAXIMUM SPANS AND CORRESPONDING LOADS SHOWN HEREIN. REFERENCE HURRICANE TEST LABORATORY (HTL OF RIVIERA BEACH, FL) TEST REPORTS #0239-0107-05 & #0239-0216-05.
- TOP & BOTTOM MOUNTING SECTIONS MAY BE INTERCHANGED AS FIELD CONDITIONS DICTATE. PANELS MAY BE MOUNTED VERTICALLY OR HORIZONTALLY AS APPLICABLE.
- USE OF KEYHOLE WASHERS IS OPTIONAL IN CONJUNCTION WITH HOLES FIELD DRILLED AT Ø3/8". IF HOLES ARE Ø1/2" OR LARGER (Ø5/8" MAX), KEYHOLE WASHERS OR WASHERED WINGNUTS WITH 1.000" MINIMUM DIAMETER SHALL BE USED. WASHERED WINGNUTS SHALL HAVE 0.865" MINIMUM WASHER DIAMETER. ALL STORM PANELS SHALL BE MOUNTED USING ANCHORS OR 1/4-20 STUDS AT EVERY VALLEY (i.e. 6.5" O.C. MAX).
- ALL BOLTS & WASHERS SHALL BE ZINC COATED STEEL, GALVANIZED STEEL, OR STAINLESS STEEL WITH A MINIMUM TENSILE YIELD STRENGTH OF 60 KSI.

ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION


Transparent Protection Systems, Inc.
6643 42nd Terrace North
West Palm Beach, FL 33407
ValueGUARD™ POLYMER STORM PANELS
AND MaxLite™ STORM PANEL SYSTEM
FLORIDA STATEWIDE APPROVAL

| DRWN | CHKD | DATE |
|------|------|----------|
| CL | FLB | 3/2/06 |
| KL | CL | 10/26/06 |
| KL | CL | 12/5/08 |
| EFT | KL | 12/13/11 |


COPYRIGHT FRANK L. BENNARDO P.E.
05-TPS-0001
SCALE: 1/07
PAGE DESCRIPTION:
1



ValueGUARD™ STORM PANEL SYSTEM
POLYOLEFIN STORM PANELS (Non-HVHZ)

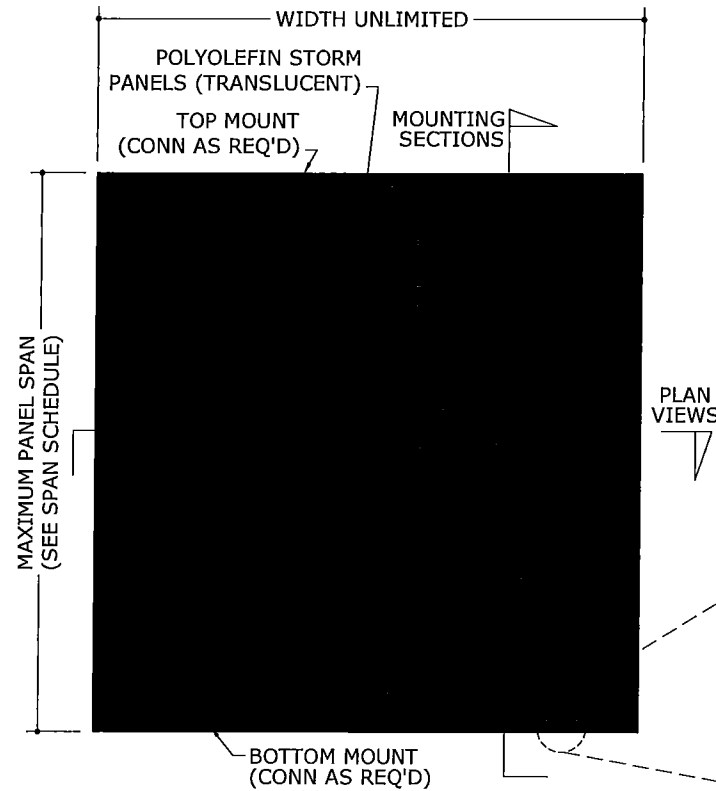


1 TYPICAL ELEVATION
2 N.T.S.

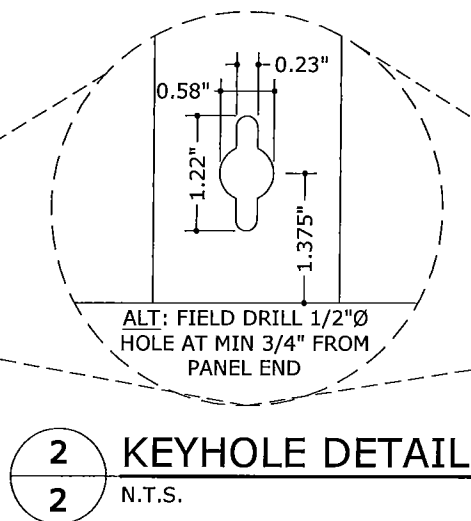

2 KEYHOLE DETAIL
2 N.T.S.

MaxLITE™ STORM PANEL SYSTEM
ALTERNATING POLYOLEFIN & POLYCARBONATE STORM PANELS (Non-HVHZ)

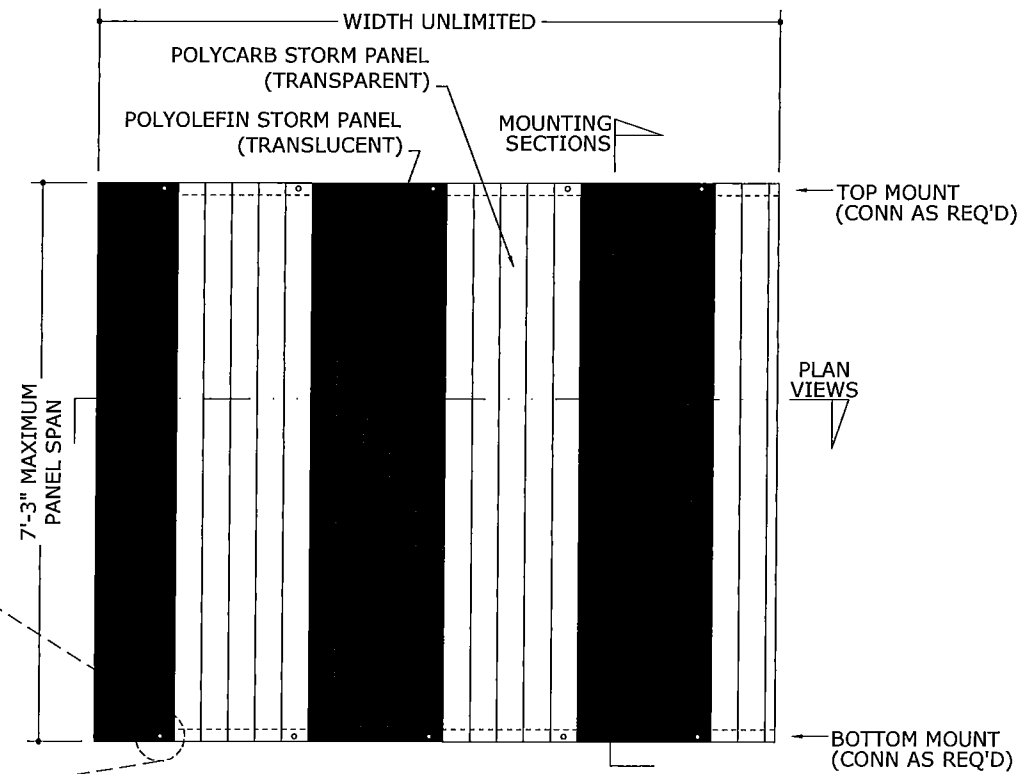

3 TYPICAL ELEVATION
2 N.T.S.

ValueGUARD™ STORM PANEL SYSTEM

MAXIMUM PANEL SPAN SCHEDULE (POSITIVE CONN.) (W/ "H" HEADERS)

| LOAD (psf) | MAX SPAN (ft) |
|------------|---------------|
| ± 25 | 10'-0" |
| ± 30 | 10'-0" |
| ± 35 | 10'-0" |
| ± 40 | 10'-0" |
| ± 45 | 9'-3" |
| ± 50 | 8'-8" |
| ± 55 | 8'-2" |
| ± 60 | 7'-8" |
| ± 65 | 7'-3" |
| ± 70 | 6'-4" |
| ± 75 | 5'-7" |
| ± 80 | 4'-11" |
| ± 85 | 4'-3" |
| ± 90 | 3'-9" |

| LOAD (psf) | MAX SPAN (ft) |
|------------|---------------|
| ± 26.5 | 7'-3" |
| ± 35 | 5'-10" |
| ± 55 | 4'-9" |
| ± 70 | 3'-9" |

MAXIMUM SPAN SCHEDULE NOTES:

1. SPANS SHOWN IN MAX PANEL SPAN SCHEDULES ARE MAXIMUM ALLOWABLE SPANS AT EACH RESPECTIVE DESIGN PRESSURE.
2. "POSITIVE CONNECTION" SPAN SCHEDULE MAY BE USED TO DETERMINE MAXIMUM ALLOWABLE SPANS FOR PANELS INSTALLED USING ANY COMBINATION OF MOUNTING EXTRUSIONS INVOLVING A POSITIVE CONNECTION - i.e. ALL INSTALLATIONS WHICH DO NOT INCLUDE AN "H" HEADER.
3. SPAN SCHEDULE LABELLED FOR USE "WITH 'H' HEADERS" MUST BE USED FOR ALL INSTALLATIONS WHERE THE "H" HEADER IS USED.
4. ALL TABLES ARE VALID FOR PANELS MOUNTED HORIZONTALLY OR VERTICALLY. SPAN DIRECTION IS ALWAYS PERPENDICULAR TO LINE OF ANCHORAGE.

MaxLITE™ STORM PANEL SYSTEM

MAX PANEL SPAN: 7'-3"
MAX DESIGN LOAD: ±65 PSF

NOTE: MaxLITE™ STORM PANEL SYSTEM IS NOT VALID FOR USE WITH "H" HEADERS.

FRANK L. BENNARDO, P.E.
PE0046549

12/14/2011



ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A. FRANK L. BENNARDO, P.E., INC. INNOVATION

Transparent Protection Systems, Inc.
6643 42nd Terrace North
West Palm Beach, FL 33407
ValueGUARD™ POLYMER STORM PANELS
AND MaxLite™ STORM PANEL SYSTEM
FLORIDA STATEWIDE APPROVAL

| REMARKS | DRWN | CHKD | DATE |
|----------------------|------|------|----------|
| INIT ISSUE | CL | FLB | 3/2/06 |
| "H" HEADER / MAXLITE | KL | CL | 10/26/06 |
| 2007 FBC | KL | CL | 12/21/08 |
| 2010 FBC UPDATE | EFT | KL | 12/13/11 |


THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF FRANK L. BENNARDO, P.E. ALTERNATIONS, ADDITIONS, DELETIONS OR OTHER MODIFICATIONS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT FRANK L. BENNARDO P.E.


05-TPS-0001

SCALE: 07
PAGE DESCRIPTION:


F:\01 Project Files\Transparent Protection (TPS)\2005 Jobs\05-TPS-0001 ValueGuard Polyolefin Storm Panels (FSA).dwg

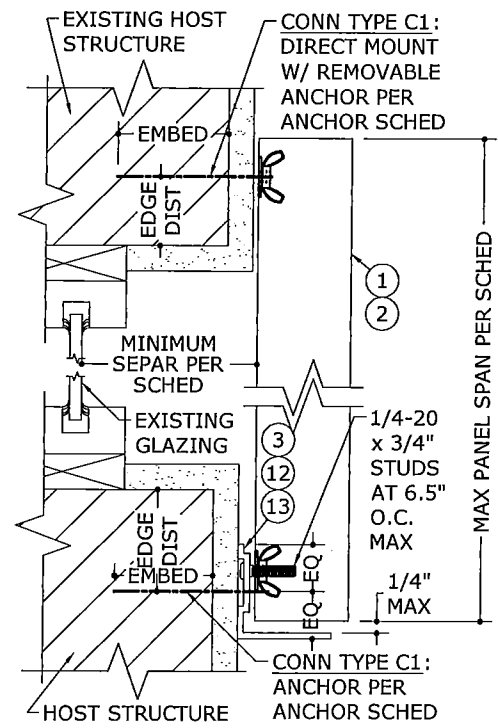


1 MOUNTING SECTION
3 3" = 1'-0" VERT SECTION

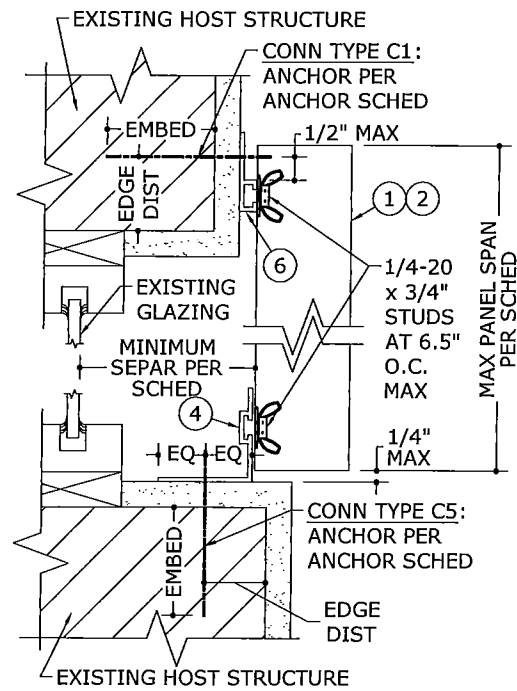


2 MOUNTING SECTION
3 3" = 1'-0" VERT SECTION

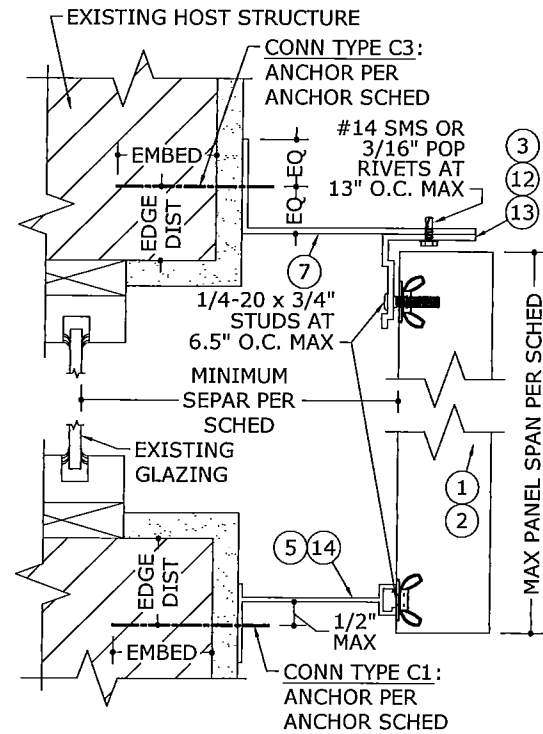


3 MOUNTING SECTION
3 3" = 1'-0" VERT SECTION

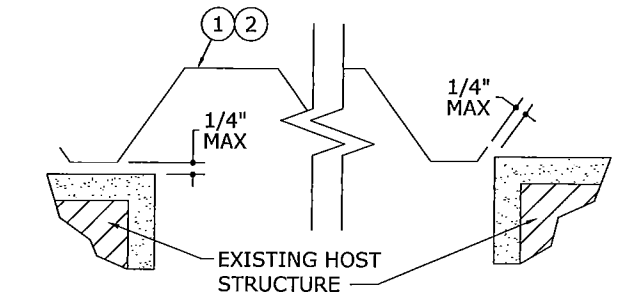


6 WALL MOUNT CLOSURE
3 3" = 1'-0" PLAN VIEW

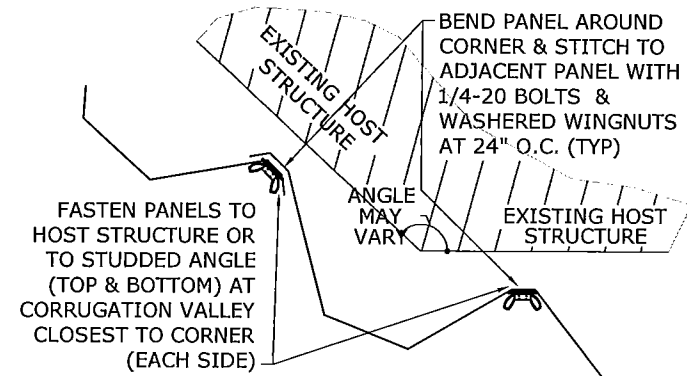


7 CORNER CLOSURE
3 N.T.S. PLAN VIEW

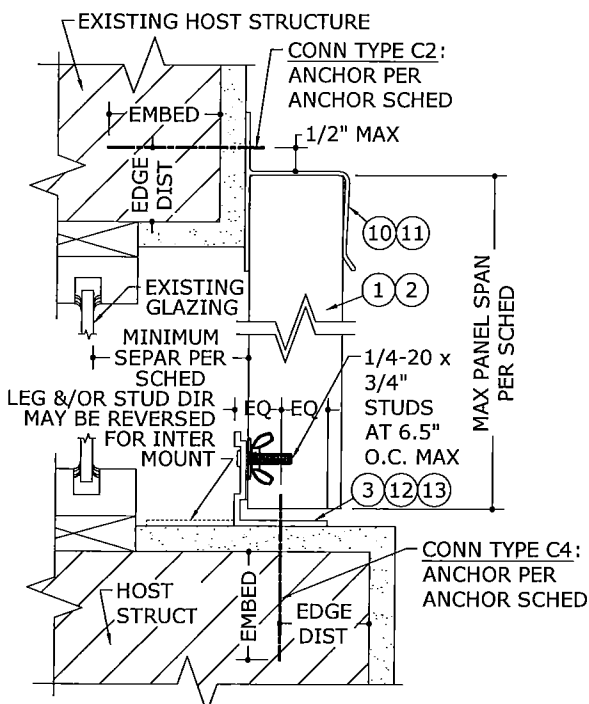


4 MOUNTING SECTION
3 3" = 1'-0" VERT SECTION

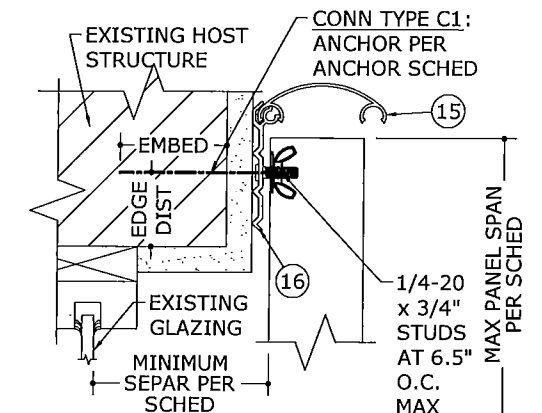


5 MOUNTING SECTION
3 N.T.S. VERT SECTION

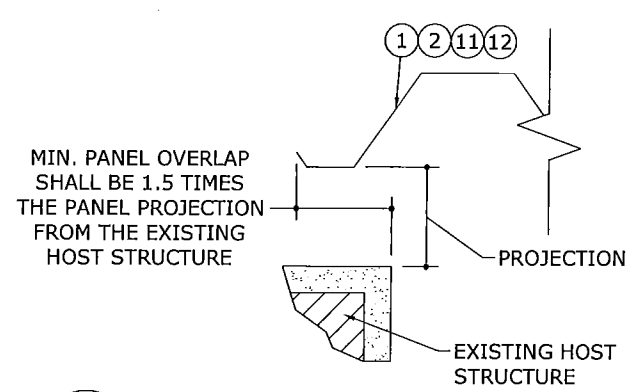


10 PANEL OVERLAP
3 N.T.S. PLAN VIEW

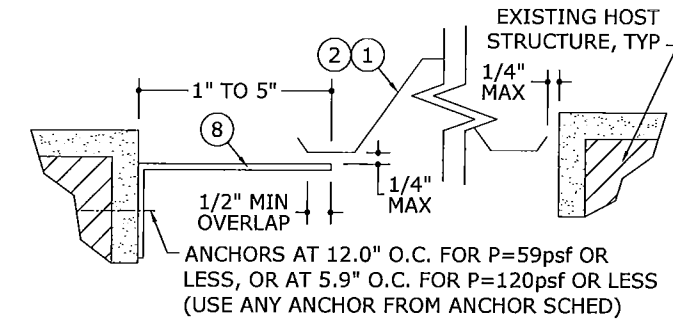

8 TRAP MOUNT CLOSURE
3 3" = 1'-0" PLAN VIEW

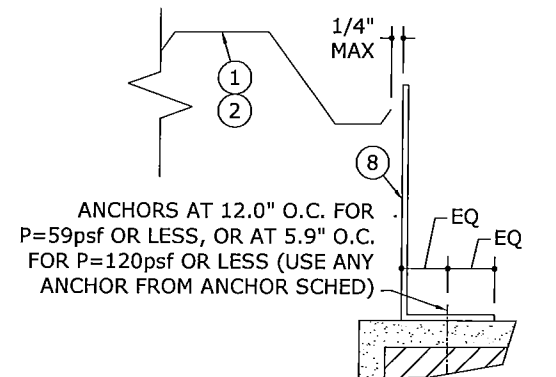

9 BUILD-OUT CLOSURE
3 3" = 1'-0" PLAN VIEW

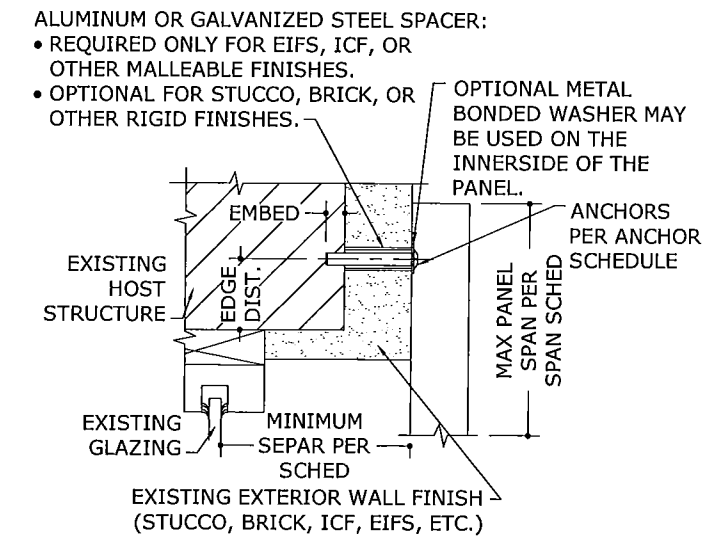

11 MOUNTING SECTION THRU EXTERIOR WALL FINISH (BRICK, ICF, EIFS, ETC.)
3 N.T.S. VERT SECTION

FRANK L. BENNARDO, P.E.
PE0046549
12/14/2011

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #8888
A FRANK L. BENNARDO, P.E., INC. INNOVATION

Transparent Protection Systems, Inc.
6643 42nd Terrace North
West Palm Beach, FL 33407
ValueGuard™ POLYMER STORM PANELS
AND MaxLite™ STORM PANEL SYSTEM
FLORIDA STATEWIDE APPROVAL

| DRWN | CHKD | DATE |
|------|------|----------|
| KL | FLB | 3/2/06 |
| KL | CL | 10/26/06 |
| KL | CL | 12/31/08 |
| KL | KL | 12/13/11 |

REMARKS: THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. ANY REPRODUCTION OR TRANSMISSION OF THIS DOCUMENT WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. IS PROHIBITED. ANY REVISIONS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT FRANK L. BENNARDO P.E.
05-TPS-0001
SCALE: 1/8" = 1'-0"
PAGE DESCRIPTION: 07

12/14/2011 - 6:56pm keith F:\01 Project Files\Transparent Protection (TPS)\2005 Jobs\05-TPS-0001 ValueGuard Polyolefin Storm Panels (FSA).dwg

ValueGUARD™ STORM PANEL SYSTEM

GLASS SEPARATION SCHEDULE (POSITIVE CONN.)

| POSITIVE DESIGN PRESSURE | SHUTTER SPAN UP TO | MINIMUM SEPARATION FROM GLASS | |
|--------------------------|--------------------|---------------------------------|---------------------------------|
| | | INSTALLATIONS ≤ 30' ABOVE GRADE | INSTALLATIONS > 30' ABOVE GRADE |
| 25 PSF | 45" | 5.6" | 1.2" |
| | 60" | 10.6" | 1.7" |
| | 90" | 10.6" | 4.5" |
| | 120" | 10.6" | 5.8" |
| 35 PSF | 45" | 5.6" | 1.3" |
| | 60" | 10.6" | 2.0" |
| | 90" | 10.6" | 5.9" |
| | 120" | 10.6" | 7.7" |
| 45 PSF | 45" | 5.6" | 1.4" |
| | 60" | 10.6" | 2.2" |
| | 90" | 10.6" | 7.3" |
| | 111" | 10.6" | 8.6" |
| 60 PSF | 45" | 5.6" | 1.5" |
| | 60" | 10.6" | 2.6" |
| | 90" | 10.6" | 9.4" |
| | 92" | 10.6" | 9.4" |
| 75 PSF | 45" | 5.6" | 1.6" |
| | 60" | 10.6" | 3.0" |
| | 67" | 10.6" | 4.3" |
| 90 PSF | 45" | 5.6" | 1.7" |

NOTE: SEPARATION FROM GLAZING IS REQUIRED ONLY IN ASTM WIND ZONE 4 AND ESSENTIAL FACILITIES.

GLASS SEPARATION SCHEDULE (W/ "H" HEADERS)

| SHUTTER SPAN UP TO | MINIMUM SEPARATION FROM GLASS | |
|--------------------|---------------------------------|---------------------------------|
| | INSTALLATIONS ≤ 30' ABOVE GRADE | INSTALLATIONS > 30' ABOVE GRADE |
| 87" | 10.6" | 3.9" |
| 70" | 10.6" | 3.0" |
| 57" | 10.6" | 2.8" |
| 45" | 8.1" | 2.0" |

NOTE: SEPARATION FROM GLAZING IS REQUIRED ONLY IN ASTM WIND ZONE 4 AND ESSENTIAL FACILITIES.

MaxLITE™ STORM PANEL SYSTEM

GLASS SEPARATION SCHEDULE (MaxLITE™ STORM PANEL)

| SHUTTER SPAN UP TO | MINIMUM SEPARATION FROM GLASS | |
|--------------------|---------------------------------|---------------------------------|
| | INSTALLATIONS ≤ 30' ABOVE GRADE | INSTALLATIONS > 30' ABOVE GRADE |
| 87" | 13.7" | 10.7" |

NOTE: SEPARATION FROM GLAZING IS REQUIRED ONLY IN ASTM WIND ZONE 4 AND ESSENTIAL FACILITIES.

FRANK L. BENNARDO, P.E.
PE0046549

12/14/2011



ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

Transparent Protection Systems, Inc.

TPS

6643 42nd Terrace North
West Palm Beach, FL 33407

ValueGUARD™ POLYMER STORM PANELS
AND MaxLite™ STORM PANEL SYSTEM
FLORIDA STATEWIDE APPROVAL

| REMARKS | DRWN | CHKD | DATE |
|----------------------|------|------|----------|
| INIT ISSUE | CL | FLB | 3/2/06 |
| "H" HEADER / MAXLITE | KL | CL | 10/26/06 |
| 2007 FBC | KL | CL | 12/31/08 |
| 2010 FBC UPDATE | EFT | KL | 12/13/11 |

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. REPRODUCTION OR TRANSMISSION OF THIS DOCUMENT WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E. IS PROHIBITED. ANY ALTERATIONS, ADDITIONS, DELETIONS, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT FRANK L. BENNARDO P.E.

05-TPS-0001

SCALE: 07

PAGE DESCRIPTION: